


ANALYS AV BÄRLAGERGRUS 0-31,5 mm

Entreprenör:	Provt.datum:	20241029	Lab Provnr:	2004272
Objekt:	Märkning:			
Leverantör:	Provtagn.plats:	Flivik		
Produkt:	Provtagare:	SJ		
Bärlager 0/32 mm				

Analysresultat:

Noteringar

Produktionskontroll
Tvättsiktat
EB

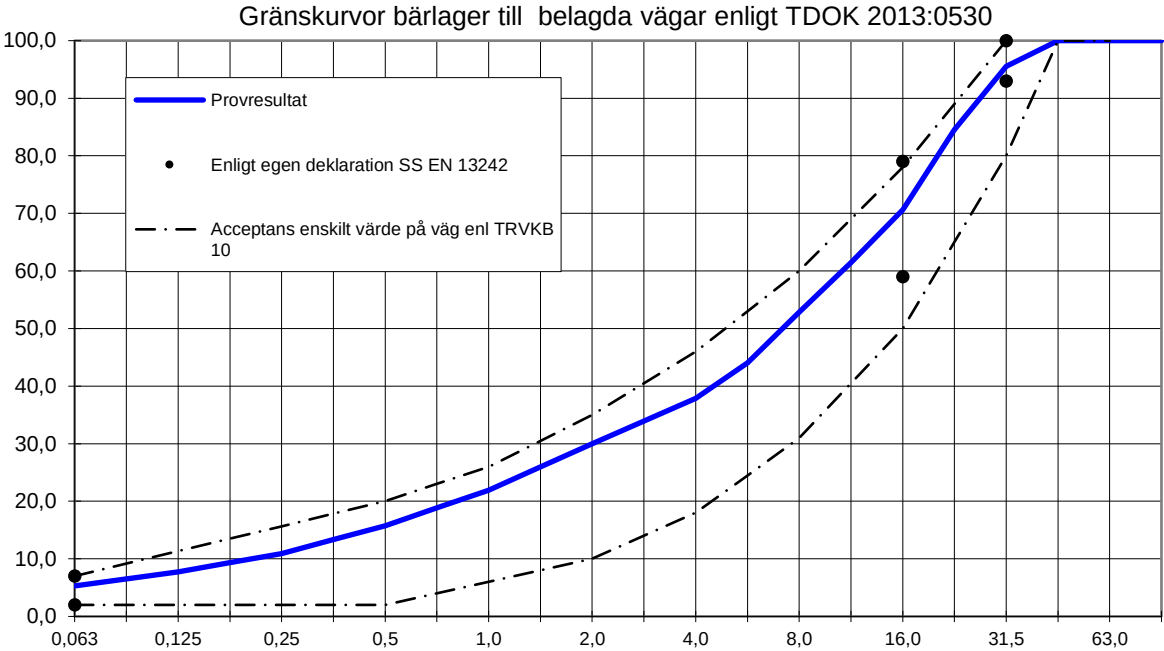

Passerande mängd vikt-% vid sikt mm

0,063 mm	0,125 mm	0,25 mm	0,5 mm	1,0 mm	2,0 mm	4,0 mm	5,6 mm	8,0 mm	11,2 mm	16,0 mm	22,4 mm	31,5 mm	45,0 mm	63,0 mm	90,0 mm
5,3	7,7	10,9	15,7	21,9	30,0	37,9	44,1	52,8	61,4	70,6	84,5	95,6	100,0	100,0	100,0