


ANALYS AV BÄRLAGERGRUS 0-31,5 mm

Entreprenör:	Provt.datum: 20250604	Lab Provnr: 2004324
Objekt:	Märkning:	
Leverantör:	Provtagn.plats: Flivik	
Produkt: Bärlager 0/32 mm	Provtagare: AS	

Analysresultat:

Noteringar

Produktionskontroll
Tvättsiktat
EB

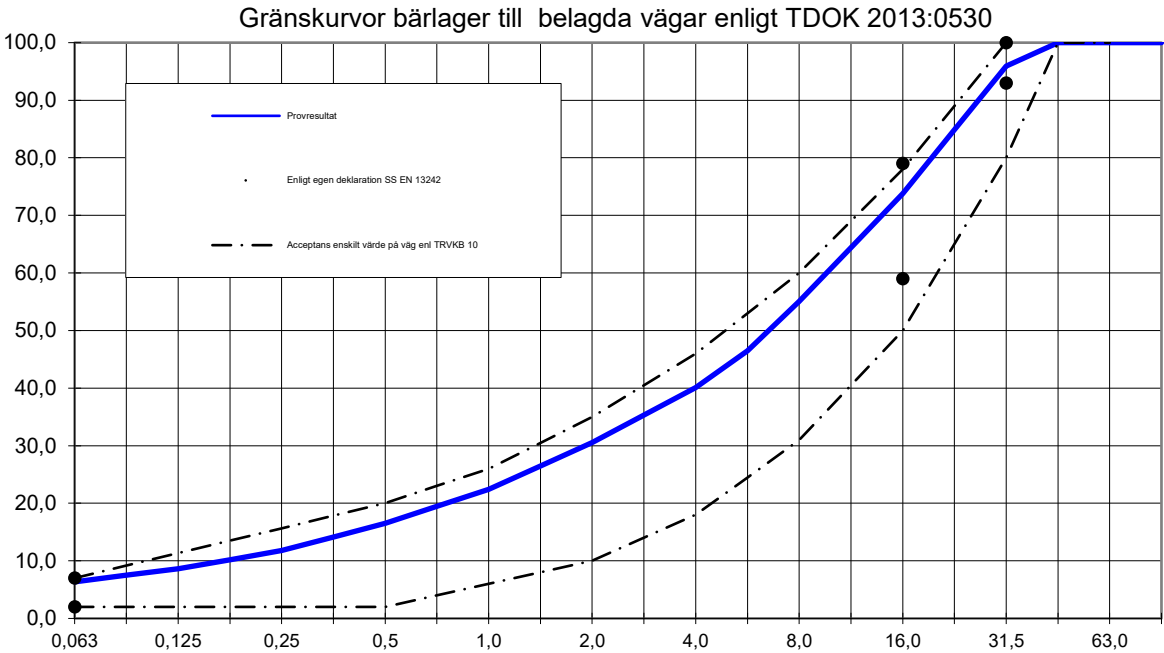

Passerande mängd vikt-% vid sikt mm

0,063 mm	0,125 mm	0,25 mm	0,5 mm	1,0 mm	2,0 mm	4,0 mm	5,6 mm	8,0 mm	11,2 mm	16,0 mm	22,4 mm	31,5 mm	45,0 mm	63,0 mm	90,0 mm
6,4	8,7	11,8	16,5	22,4	30,5	40,1	46,5	55,1	64,4	73,8	84,8	95,9	100,0	100,0	100,0